

Combinations:

SKP70...


SKP70...	VGG10...	For SKP70.191U..
	VGF10...	SKP70.192U..
	VGH...	see also instruction
	VGD...	M7641.4x

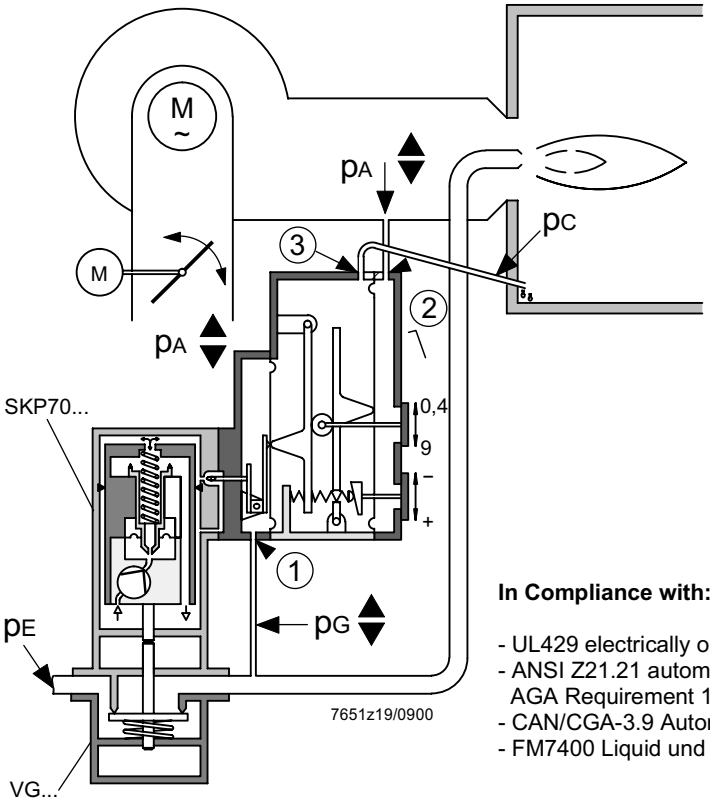


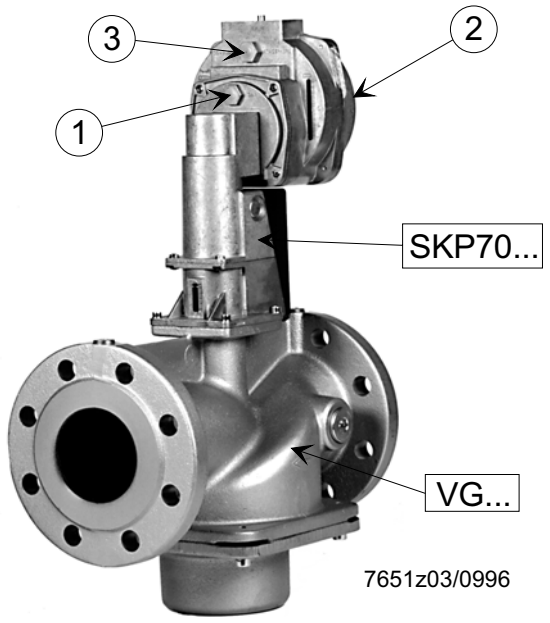


In Compliance with:


- UL429 electrically operated valves
- ANSI Z21.21 automatic valves and AGA Requirement 10-93
- CAN/CGA-3.9 Automatic Safety shut-off valves
- FM7400 Liquid und Gas Safety shut-off valves

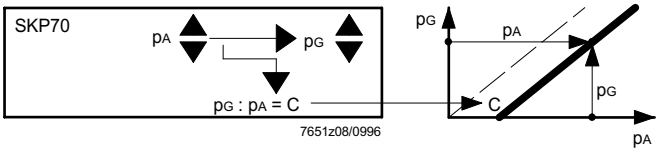


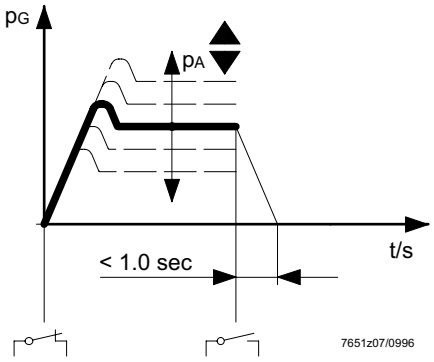


p:	**mbar/psi (1 psi = 69 mbar)**
pG:	**pGas**
pA:	**pAir**
pC:	**pCombustion**
pGmax. =	**100 mbar = 1,45 psi**
pAmax. =	**50 mbar = 0,72 psi**
pEmax. w	**VG...**

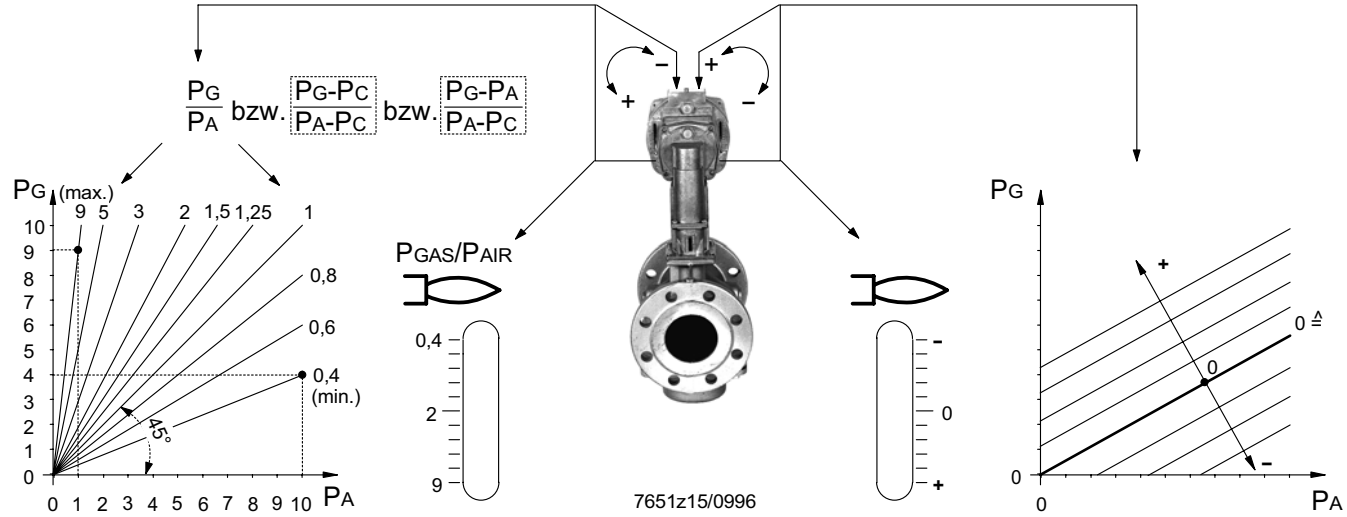


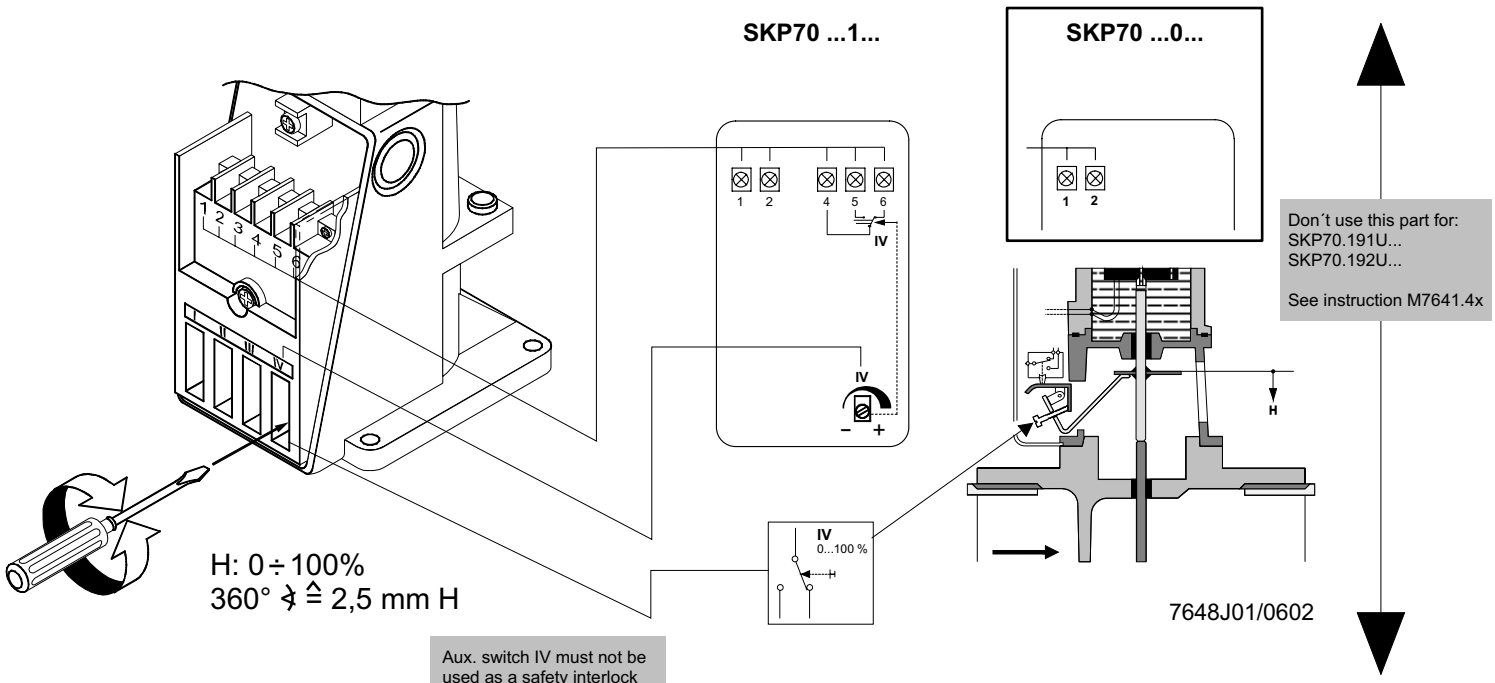


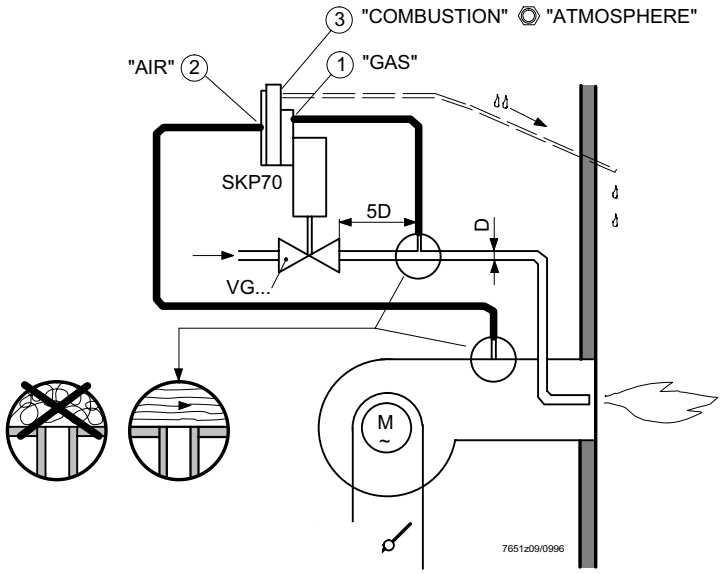


Wiring must conform to current local codes, e.g. NATIONAL ELECTRICAL CODE ANSI/NFPA 70, CBA C22.1 CANADIAN ELECTRICAL CODE

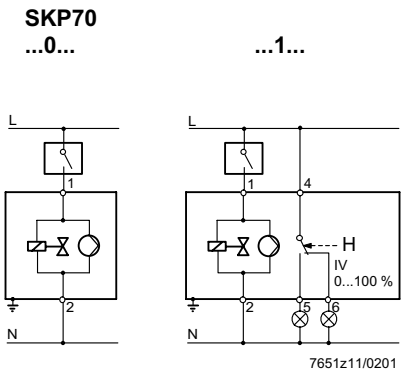

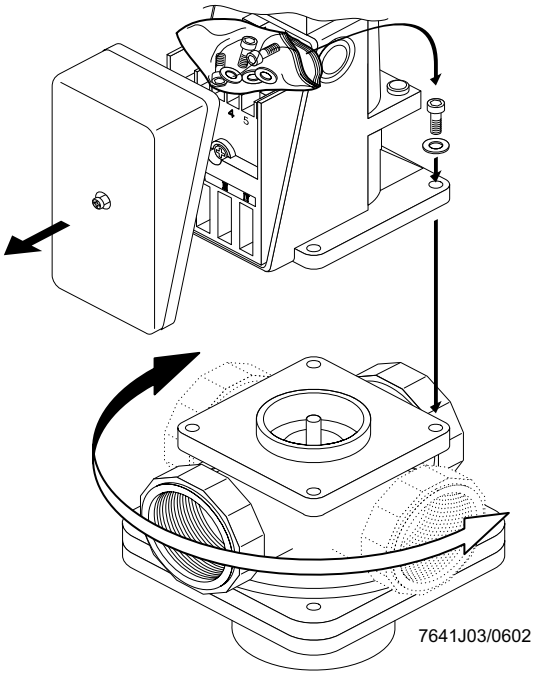



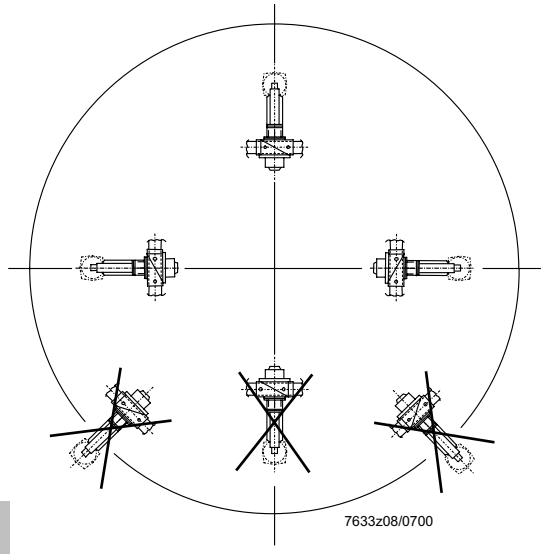

NEMA
1, 2, 5 and 12
Enclosure for indoor use

© Siemens Building Technologies Ltd.